



LEVEL



FLOW



PRESSURE



TEMPERATURE



ELECTRONICS



## Датчики уровня серии LINEAR – LCV

Архангельск (8182)63-90-72  
Астрахань (8512)99-46-04  
Барнаул (3852)73-04-60  
Белгород (4722)40-23-64  
Брянск (4832)59-03-52  
Владивосток (423)249-28-31  
Волгоград (844)278-03-48  
Вологда (8172)26-41-59  
Воронеж (473)204-51-73  
Екатеринбург (343)384-55-89  
Иваново (4932)77-34-06

Ижевск (3412)26-03-58  
Иркутск (395)279-98-46  
Казань (843)206-01-48  
Калининград (4012)72-03-81  
Калуга (4842)92-23-67  
Кемерово (3842)65-04-62  
Киров (8332)68-02-04  
Краснодар (861)203-40-90  
Красноярск (391)204-63-61  
Курск (4712)77-13-04  
Липецк (4742)52-20-81

Киргизия (996)312-96-26-47

Магнитогорск (3519)55-03-13  
Москва (495)268-04-70  
Мурманск (8152)59-64-93  
Набережные Челны (8552)20-53-41  
Нижний Новгород (831)429-08-12  
Новокузнецк (3843)20-46-81  
Новосибирск (383)227-86-73  
Омск (3812)21-46-40  
Орел (4862)44-53-42  
Оренбург (3532)37-68-04  
Пенза (8412)22-31-16

Казахстан (7273)495-231

Пермь (342)205-81-47  
Ростов-на-Дону (863)308-18-15  
Рязань (4912)46-61-64  
Самара (846)206-03-16  
Санкт-Петербург (812)309-46-40  
Саратов (845)249-38-78  
Севастополь (8692)22-31-93  
Симферополь (3652)67-13-56  
Смоленск (4812)29-41-54  
Сочи (862)225-72-31  
Ставрополь (8652)20-65-13

Таджикистан (992)427-82-92-69

Сургут (3462)77-98-35  
Тверь (4822)63-31-35  
Томск (3822)98-41-53  
Тула (4872)74-02-29  
Тюмень (3452)66-21-18  
Ульяновск (8422)24-23-59  
Уфа (347)229-48-12  
Хабаровск (4212)92-98-04  
Челябинск (351)202-03-61  
Череповец (8202)49-02-64  
Ярославль (4852)69-52-93

Единый адрес для всех регионов: [vck@nt-rt.ru](mailto:vck@nt-rt.ru) || <https://valco.nt-rt.ru/>



### GENERAL CHARACTERISTICS

Level measurement with capacitive technology.  
 The liquid to be monitored must have a minimum conductivity of 50  $\mu\text{S} / \text{cm}$  and must not be adherent to the probe.  
 All programming functions can be managed from the keypad on the front panel of the instrument.  
 Level status is displayed on the LCD.  
 The analog signal is proportional to the measured level, and can be calibrated according to the geometry of the tank.  
 The absence of moving parts offers a system that does not require particular maintenance.

- **Measuring ranges 100 ... 3000 mm**
- Accuracy  $\pm 0,5\%$  of measured value ( $\pm 2$  mm).
- Programming via the front panel keypad and LCD display.
- Additional Teach-in function.
- Measuring units programmable in linear values or %.
- Signal indication with 2 three-color LED.
- NPN output with short-circuit protection programmable NO or NC.
- 0 ÷ 10 V or 4-20mA analog output.
- Operating temperature range -25/+70°C.
- Degree of protection IP65



### TECHNICAL DATA



Tab.1

Power supply	
Power supply voltage	14 30 Vdc – self powered loop
Ambient temperature range	-10 ... 50 °C
Process temperature range	<b>1</b> 0 ... 60 °C <b>2</b> 0 ... 120°C
Max. process pressure	16 bar
Electrical output (insulated)	level / temperature / alarms
Test voltage	500 Vdc
Reference standards	EN50022 , IEC61000-4-3/4/5
Level measurement	
Measuring ranges	From 0 ÷ 100 mm to 0 ÷ 3000 mm
Programmable measuring units	m – cm – mm – in – ft – yd
Measuring frequency	400 kHz max.
Sampling period	1 s
Decimals	0 ... 3 depending on measuring range
Medium conductivity	> 50 $\mu\text{S}/\text{cm}$
Medium viscosity	< 2000 $\text{mm}^2/\text{s}$ (cSt)
Accuracy	$\pm 0,5\%$ of measured value ( $\pm 2$ mm).
Temperature coefficient	0,06 % / K <b>LCV 1</b>
	0,01 % / K <b>LCV 2</b>
Temperature measurement	
Temperature sensor	RTD (Pt100), B class
Programmable measuring units	°C – °F
Programmable measuring ranges	-40 ... +160 °C <b>LCV 2</b>
	-40 ... +320 °F
Decimals	1
Accuracy	$\pm 0,2$ °C

Analog output	
Output signal	4 – 20 mA
Load	RA[ $\Omega$ ] $\leq$
	Power supply – 14 V 0.02A
Adjusting range	initial    3,800 ... 5,000 mA
	final    19,000 ... 21,000 mA
Accuracy	0,1 %
Temperature coefficient	0,007 % / K
Alarm output	
Transistor	14...30Vcc, 60mA max. load
Voltage drop	< 2 V, with max. load
Display	
Dot matrix LCD	Character height 4,9 mm
Characters	2 lines, 16 characters each
Housing	
Material	Polyamide + glass fiber
Dimensions	100 x 100 x 60 (WxHxD)
Weight	360 g. max.
Terminal board	Screws terminals – 2,5 $\text{mm}^2$
Degree of protection	<b>IP65</b>
Measuring probe	
Material	PTFE, aluminium core $\varnothing 16$ mm
Connection	Stainless steel AISI-316L
Medium temperature range	<b>1</b> 0 ... 60°C
	<b>2</b> -10 ... 120°C
	140°C, steam sterilization
Sealing gaskets	EPDM, FDA approved
Minimum immersion length <b>M</b>	<b>1</b> 20 mm – metal tank
	<b>2</b> 60 mm – plastic tank
	<b>4</b> 60 mm – with 2 <sup>nd</sup> ref. electrode
Standard lengths <b>EL</b> mm	500
	800
	1000
	1500    2000    2500

## INSTALLATION – DIMENSIONS mm.


Tab.2

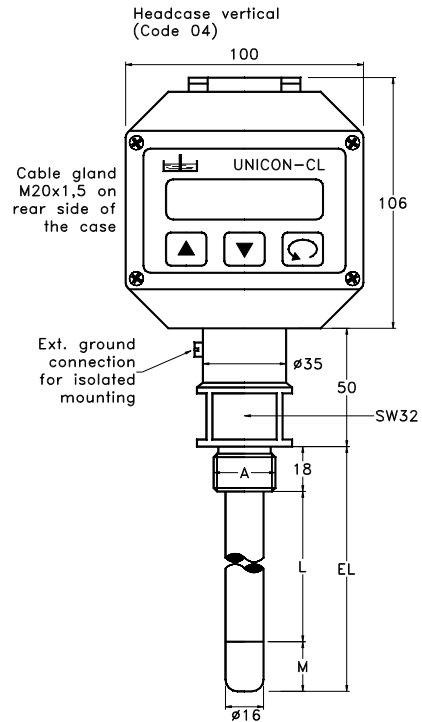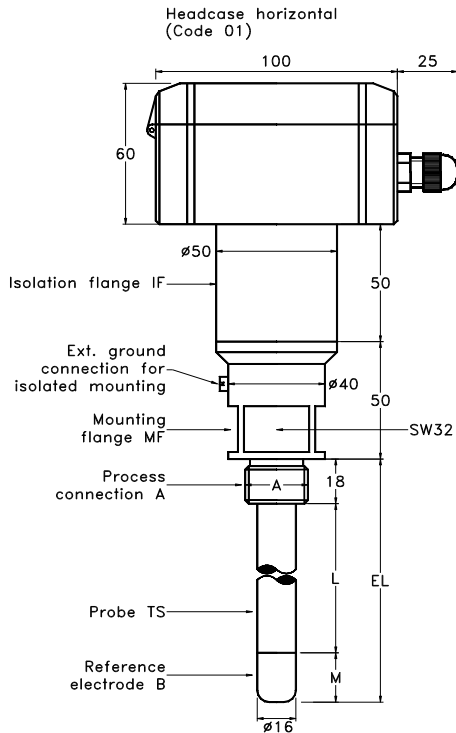


<b>IF</b>	PVDF insulation - only for temperature -10 ...120°C (140°C)
<b>MF</b>	Mounting flange AISI 316
<b>A</b>	Process connection 3/4" G-Male
<b>TS</b>	Measuring probe – PTFE coating, aluminium core Ø16 mm

<b>B</b>	Metal reference electrode (plastic tank)
<b>EL</b>	Measuring length, standard lengths see Tab. 1
<b>L</b>	Linear measuring range - 20 (60) ... 2962 (2922) mm.
<b>M</b>	Minimum immersion length - start of linear measurement

## WIRING

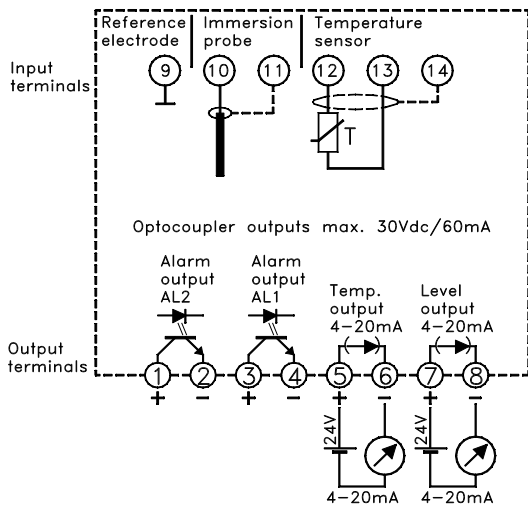

For supplying the UNICON-CL use terminals 7-8. If UNICON-CL is used for monitoring only, terminals 7-8 must be connected directly to supply

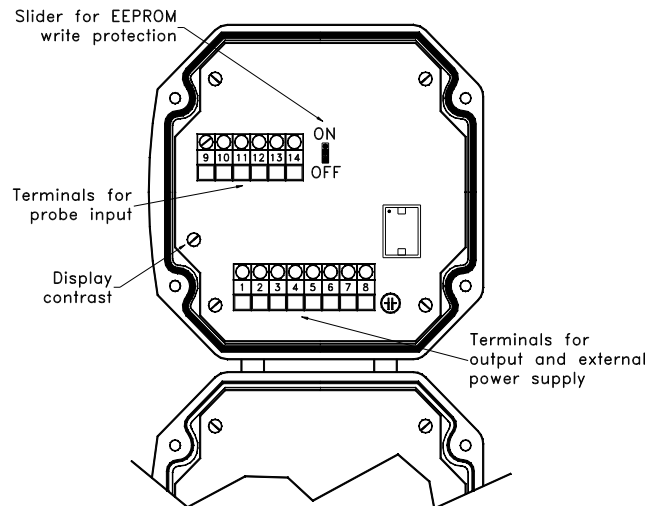

## NOMENCLATURE

LCV1	04	1	2	0800	IP65
•					
	•				
		•			
			•		
				•	
					•

	Type	LCV1 – LCV2.
Tab.2	Mounting –	Horizontal or vertical housing.
Tab.1-2	Probe –	Minimum immersion length M / type of tank.
Tab.1	Medium	temperature.
Tab.1-2	Probe	length EL.
Tab.1	Degree	of protection.

## По вопросам продажи и поддержки обращайтесь:

**Архангельск** (8182)63-90-72  
**Астрахань** (8512)99-46-04  
**Барнаул** (3852)73-04-60  
**Белгород** (4722)40-23-64  
**Брянск** (4832)59-03-52  
**Владивосток** (423)249-28-31  
**Волгоград** (844)278-03-48  
**Волгода** (8172)26-41-59  
**Воронеж** (473)204-51-73  
**Екатеринбург** (343)384-55-89  
**Иваново** (4932)77-34-06

**Ижевск** (3412)26-03-58  
**Иркутск** (395)279-98-46  
**Казань** (843)206-01-48  
**Калининград** (4012)72-03-81  
**Калуга** (4842)92-23-67  
**Кемерово** (3842)65-04-62  
**Киров** (8332)68-02-04  
**Краснодар** (861)203-40-90  
**Красноярск** (391)204-63-61  
**Курск** (4712)77-13-04  
**Липецк** (4742)52-20-81

**Киргизия** (996)312-96-26-47

**Магнитогорск** (3519)55-03-13  
**Москва** (495)268-04-70  
**Мурманск** (8152)59-64-93  
**Набережные Челны** (8552)20-53-41  
**Нижний Новгород** (831)429-08-12  
**Новокузнецк** (3843)20-46-81  
**Новосибирск** (383)227-86-73  
**Омск** (3812)21-46-40  
**Орел** (4862)44-53-42  
**Оренбург** (3532)37-68-04  
**Пенза** (8412)22-31-16

**Казахстан** (7273)495-231

**Пермь** (342)205-81-47  
**Ростов-на-Дону** (863)308-18-15  
**Рязань** (4912)46-61-64  
**Самара** (846)206-03-16  
**Санкт-Петербург** (812)309-46-40  
**Саратов** (845)249-38-78  
**Севастополь** (8692)22-31-93  
**Симферополь** (3652)67-13-56  
**Смоленск** (4812)29-41-54  
**Сочи** (862)225-72-31  
**Ставрополь** (8652)20-65-13

**Таджикистан** (992)427-82-92-69

**Сургут** (3462)77-98-35  
**Тверь** (4822)63-31-35  
**Томск** (3822)98-41-53  
**Тула** (4872)74-02-29  
**Тюмень** (3452)66-21-18  
**Ульяновск** (8422)24-23-59  
**Уфа** (347)229-48-12  
**Хабаровск** (4212)92-98-04  
**Челябинск** (351)202-03-61  
**Череповец** (8202)49-02-64  
**Ярославль** (4852)69-52-93

Единый адрес для всех регионов: [vck@nt-rt.ru](mailto:vck@nt-rt.ru) || <https://valco.nt-rt.ru/>



LEVEL



FLOW



PRESSURE



TEMPERATURE



ELECTRONICS